


Assured Grounding – Fallen Phrases

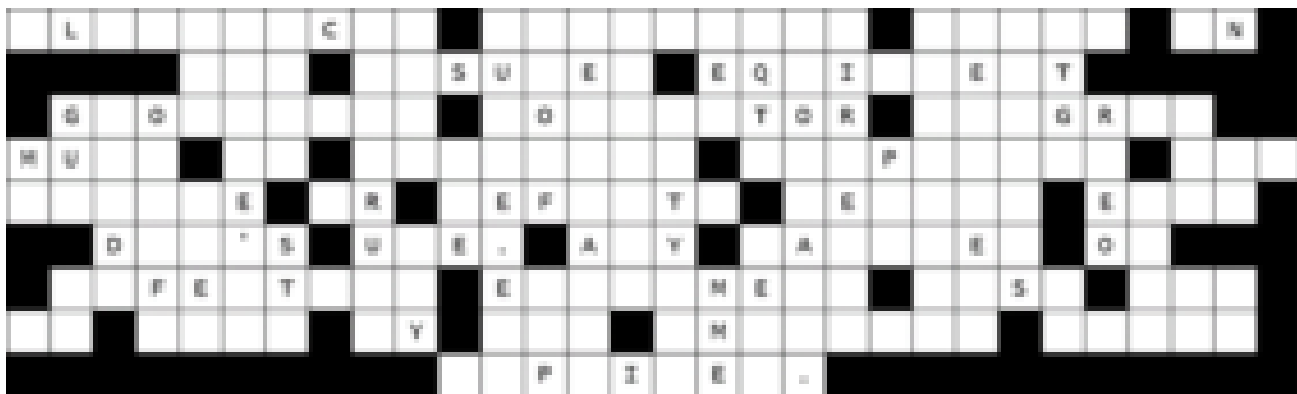

E
 E I
 E
 U C V G U C V N H O T C
 R T T N E A L U A N L E I B T P E N T I
 S C S B D N S T H U D P D U O P O R E T A P L
 B E E A Y E E O B E R C R L N R S P N S Y G U T U N N I T
 E D M A T R D I V S D E Q A I Y C E L T F N C O E D A O O
 D A E V G H I I A I S E Q E D P H D N H A H R D E O R H H R

Answers

Electrical equipment noted in the assured equipment grounding conductor program must be visually inspected for damage or defects before each day's use. Any damaged or defective equipment must not be used by the employee until repaired.